

**The City of New York**  
**Approved Liquid Level Measurement & Leak Detection Systems**  
 INCON Model Numbers:  
 TS-504 & TS-508  
 Approval # 4994 – Approved 4/13/01

And INCON Model Numbers:  
 TS-1001, TS-2001, TS-1000, & TS-2000  
 Approval # 4852 – Approved 8/17/99


**INCON P/N: 240-0101 Rev. B**

# New York City Approval Label



**This adhesive-backed label is affixed to the exterior of an INCON Automatic Tank Gauge & Leak Detection console to comply with the requirements of The City of New York, NY.**

Location — it is placed vertically or horizontally on the top of the enclosure as show below:

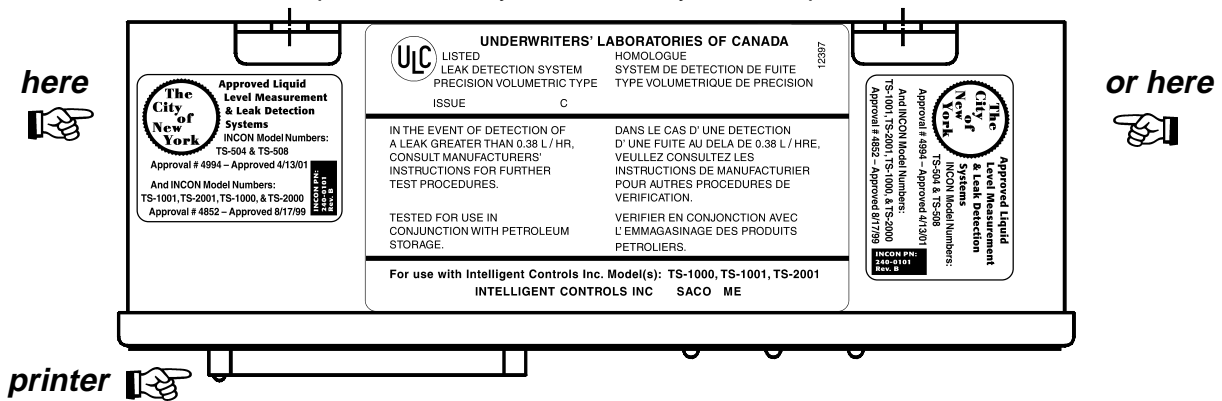

*INCON ATG & Leak Detection System Console – Top View*

## Conditions or Approval – Excerpts from the City of New York FIRE DEPARTMENT – Certificate of Approval # 4994 and # 4852

- An overfill and/or leak condition shall activate an audible and visual alarm and shall give an indication on the control panel. The alarm may be silenced when acknowledged, however, the visual indication shall remain on as long as the condition exists. Upon detection of an additional leak, the audible alarm shall be reactivated.
- Audible and visual alarm shall be installed in the principal working area of the individual responsible for motor fuel dispensing operations, including the monitoring of the leak detection system.
- The installation and use of leak detection device shall comply with applicable New York City Code rules and regulations, including 3RCNY § 21-20 and/or 3RCNY § 21-21. Manufacturer's and Underwriters Laboratories Inc. safety requirements, and limitations shall be complied with.

Continued next page...

- Petroleum leak detection sensor installed under dispensers shall shut off the related product pump when activated (*an INCON TS-ROM is required*).
- The INCON Tank Sentinel® tank gauge shall be Underwriters Laboratories Inc. listed and the manufacturer shall retain follow up service requirements of Underwriters Laboratories Inc.
- The INCON Tank Sentinel® liquid level tank gauge and leak detection console shall have a UL listed or nationally recognized laboratory-approved printer installed.
- The control panel must be provided with a cylinder lock and it shall be the end user's responsibility that the panel be locked at all times to prevent unauthorized personnel from gaining access.
- Equipment shall have secured and shall maintain all required approvals and shall meet all applicable Federal and State requirements. The use of this system shall be limited to the indicated intent and has not been acceptable for other uses or applications.
- Each equipment of a type for which a Certificate of Approval shall have been issued, shall have the number of such certificate plainly and permanently stamped or otherwise fixed upon it by the manufacturer.
- The Certificate of Approval is being issued upon condition that the material or equipment's technology does not violate any patent, trade name, trade secret, or other intellectual right.
- The Fire Department Certificate of Approval does not constitute an endorsement or recommendation of the product by the Fire Department, but is a certification that the product, as represented, meets the standards as of the date of issuance.
- The NYC Fire Department reserves the right to withdraw this approval at any time in the event there is a reasonable doubt that the product does not operate or perform as required by code, the conditions of this resolution, or as represented in the application.
- End users who fail to comply with the condition as outlined in the approval will be subject to enforcement action, which may include fines and imprisonment.

To obtain a copy of the New York City Administrative Fire Code you may contact Citybooks Store at: 212-669-8246. For a copy of the Fire Department Rules of the City of New York, please contact: Lenz & Riecker, Inc., Legal Publishing Division at: 518-436-8647.

